


NSW, SAFB, QLD, BSP, MFB, CFA Landing Valves and Millcocks

Scope of Use / Specification Sheet

Hydrant Valves are available in all thread types to suit each state requirement. They are available in 90 degree and 30 degree with 65mm BSP male or 80mm roll groove inlet. All Matthews Fire Alarm valves are approved to AS 2419.2. Valves are also available in 40mm for specialist applications.

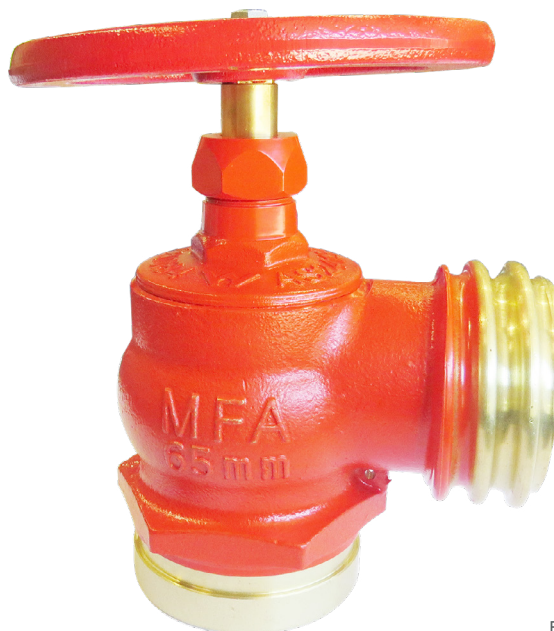

FS00292

Product List

Order Code	Description
FS00242	65mm NSWFB Landing Valve BSP Inlet
FS00902	65mm QRT Landing Valve BSP Inlet
FS00172	65mm BSP Landing Valve BSP Inlet C/W Storz
FS00342	65mm MFB Millcock BSP Inlet
FS00182	65mm CFA Millcock BSP Inlet
FS00312	65mm BSP Millcock BSP Inlet
FS00272	65mm NSWFB Landing Valve Roll Grooved Inlet
FS0049	65mm SAFB Landing Valve Roll Grooved Inlet
FS00292	65mm QRT Landing Valve Roll Grooved Inlet
FS00912	65mm BSP Landing Valve Roll Grooved Inlet
FS00382	65mm MFB Millcock Roll Grooved Inlet
FS00372	65mm CFA Millcock Roll Grooved Inlet
FS00352	65mm BSP Millcock Roll Grooved Inlet

Installation

Installation is subject to the requirements of the applicable regulatory authority, the National Construction Code Volume Three – Plumbing Code of Australia, associated reference standards as applicable at the time and AS/NZS 3500. For further Scope of Use, please visit matthewsfirealarm.com.au/brochures